


DIAMETER OF SEWER	SIZE OF T BRANCH
8"	8" x 6"
6"	6" x 6"

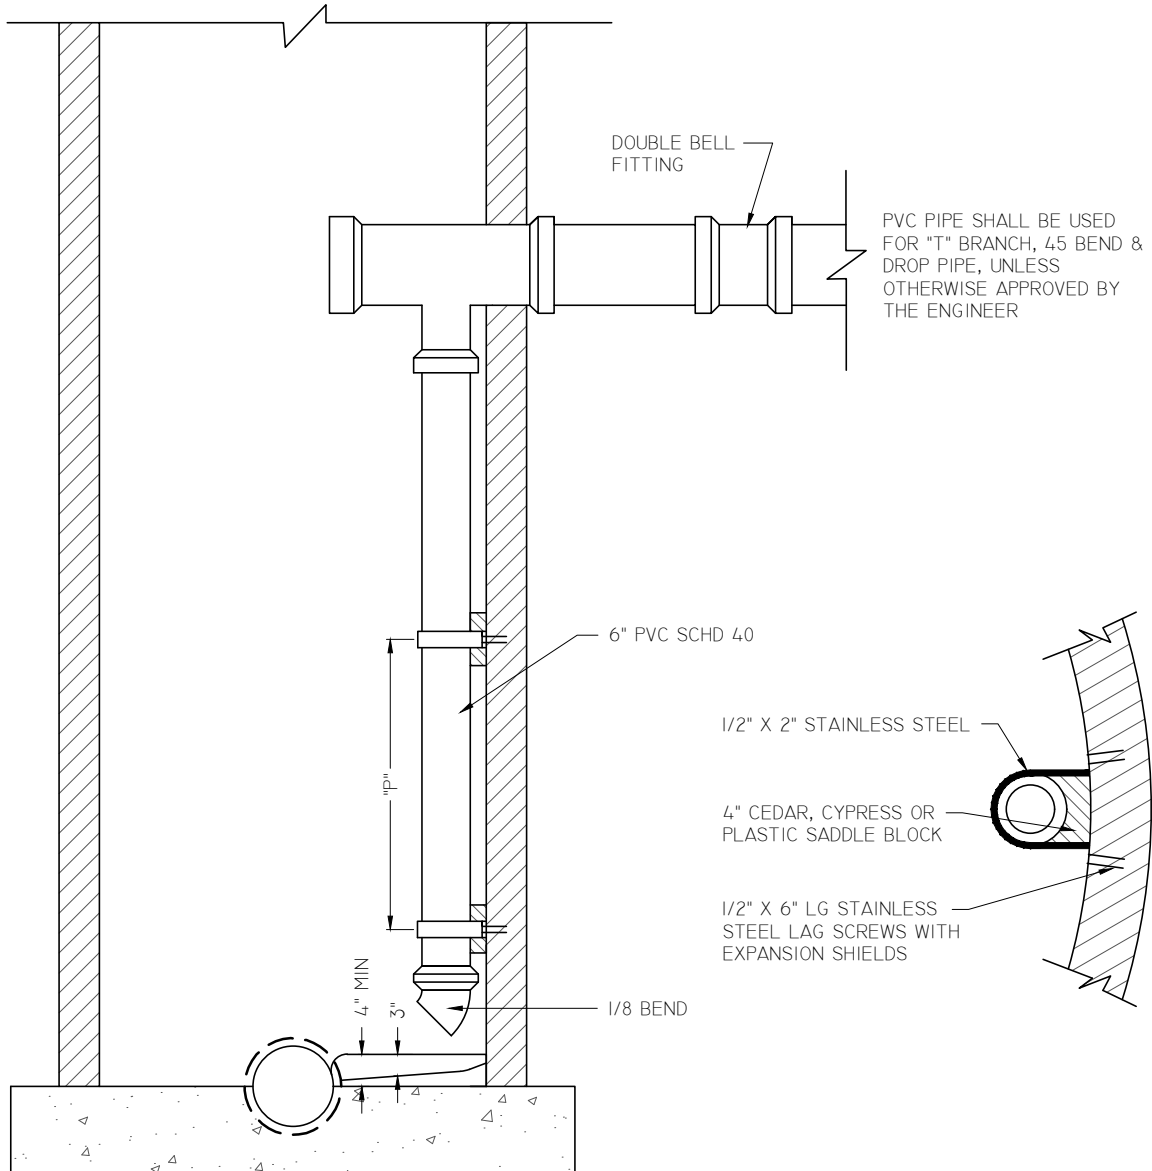

INSIDE DROP CONNECTION

SEWERS MINIMUM DROP = 3'-6"

P=5' MAX. SPACING WITH AT LEAST 3 STRAPS USED FOR EACH INSTALLATION.

THE FORMING OF A CHANNEL IN THE BENCH OF AN EXISTING MANHOLE WILL BE REQUIRED UNLESS APPROVED BY THE ENGINEER.  
THE FORMING OF ANY CHANNEL MUST BE MADE AS DIRECTED BY THE ENGINEER.

CITY OF WYOMING  
ENGINEERING DEPARTMENT

## INSIDE DROP CONNECTION

DRAWN BY - KJM  
CHECKED BY - JJO  
DATE DRAWN - 3-2021  
DATE REVISED - 3-2021

**S-12**